


GENERAL NOTES:

1. THIS CONFIGURATION MAY ONLY BE USED IN SPECIAL CASES WHEN SPECIFICALLY DESIGNED BY THE PROJECT ENGINEER AND INDICATED ON SITE PLANS.
2. ALL PIPE AND FITTINGS SHALL BE OF SAME MATERIAL.
3. ALL PIPE SHALL BE OF SAME SIZE.
4. NO BENDS ARE ALLOWED IN THE LATERAL FROM THE MAIN TO THE CLEAN OUT STACK WYE (EXCEPT AS NOTED)
5. ALL MAIN LINE TAPS ON ACTIVE MAINS SHALL BE SUPERVISED OR PERFORMED BY PSA.
6. PIPING BEHIND CLEANOUT TO BE INSTALLED PER APPLICABLE BUILDING CODE.
7. MINIMUM LATERAL SIZE:  
4' FOR RESIDENTIAL SERVICE  
6' FOR NON-RESIDENTIAL SERVICE
8. MINIMUM COVER FOR ALL SEWER LATERALS SHALL BE THREE (3') FEET.

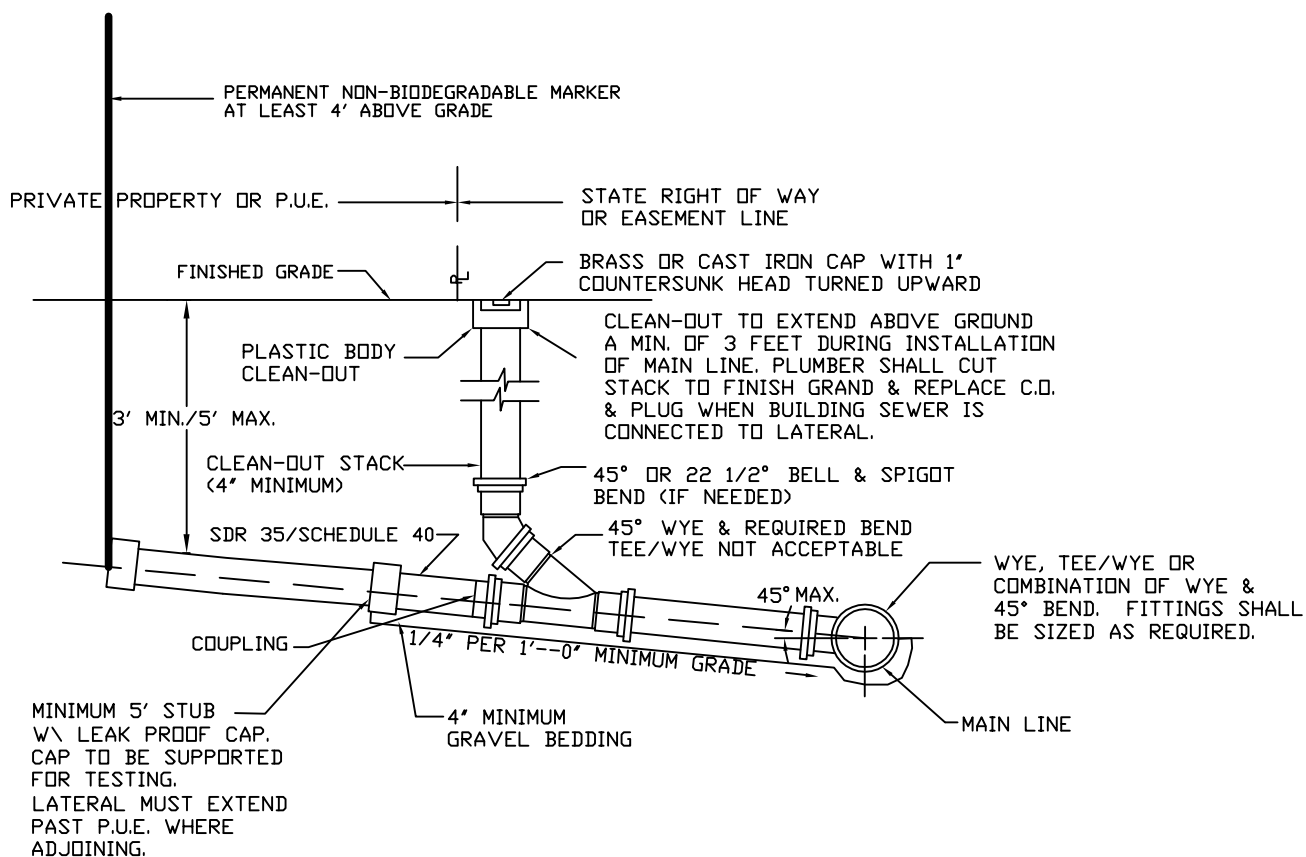

REVISIONS

NO.	DATE		
ORIGINAL	12/01/06		
1	9/01/07		

SANITARY SEWER LATERAL  
(FOR SPECIAL CASES)

DRAWING

S-09